


GENERAL NOTES:

1. NOTIFY AUTHORITY AT 257-3654 WHEN WATER SERVICE IS READY FOR INSPECTION AND TESTING. DO NOT BACKFILL ANY PORTION OF TRENCH PRIOR TO APPROVAL.
2. WATER AUTHORITY WILL SUPPLY METER AND REMOTE METER READING PAD AND THE BACKFLOW PREVENTOR FOR ALL SIZES UP TO AND INCLUDING 1".
3. PRESSURE REDUCING VALVE IS REQUIRED WHERE PRESSURE IS GREATER THAN 75 PSI.
4. METER LOCATION MUST BE APPROVED BY THE AUTHORITY.
5. ALL SERVICE LINES ARE TO BE K-TYPE TUBING ONLY WITH NO SWEAT JOINTS OR COUPLINGS UNDERGROUND.
- * 6. WATTS BACKFLOW PREVENTOR SHALL BE PROVIDED ON ALL NON-RESIDENTIAL, MULTI-FAMILY, OR MULTI-STORY SERVICES IF REQUIRED BY PRA. IF THE METER SIZE IS OVER 1" THE OWNER, NOT THE AUTHORITY, SHALL PROVIDE THE BACKFLOW PREVENTOR.
- ** 7. PRESSURE REDUCER VALVE TO BE WATTS UB5 (IF REQUIRED) - OR APPROPRIATE MODEL CORRESPONDING TO METER SIZE.
8. SIZE OF SERVICE AND METER TO BE APPROVED BY AUTHORITY.
9. SIZE OF VALVES, ADAPTERS, PRESSURE REDUCING VALVES AND BACKFLOW PREVENTORS TO BE SAME AS METER SIZE.

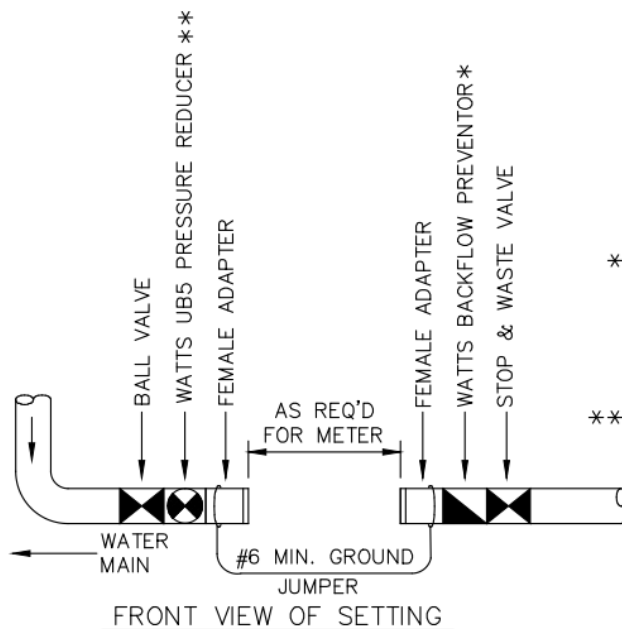

NON-RESIDENTIAL METER SETTING REQUIREMENTS

NOT TO SCALE

REVISED 7/4/12

NON-RESIDENTIAL METER SETTING REQUIREMENTS

PREPARED FOR:

PERKASIE REGIONAL AUTHORITY

ANDERSEN
ENGINEERING
ASSOCIATES
INCORPORATED

306 NORTH FIFTH STREET, PERKASIE, PA
(215) 257-5711

| | |
|---------|---------|
| DSN BY: | P.C.A. |
| CHK BY: | P.C.A. |
| DATE: | 4/08/96 |
| DWG NO. | PRA-W11 |